






SUCKING
AIRFLOW DIRECTION
SMER ZRAKA

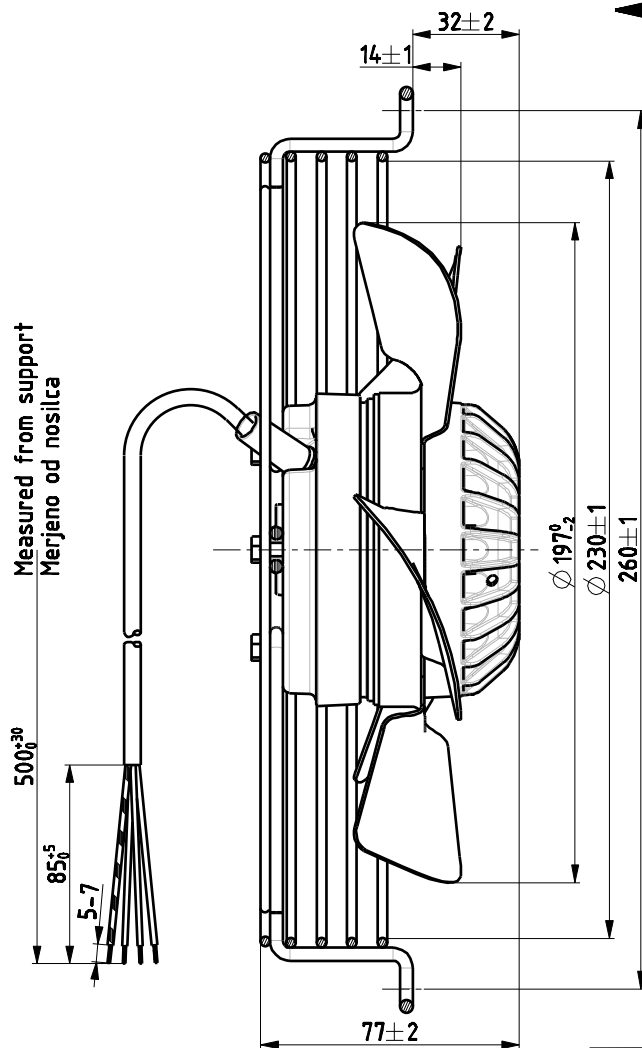

Capacitor delivered separately
Kondenzator se dobavlja ločeno

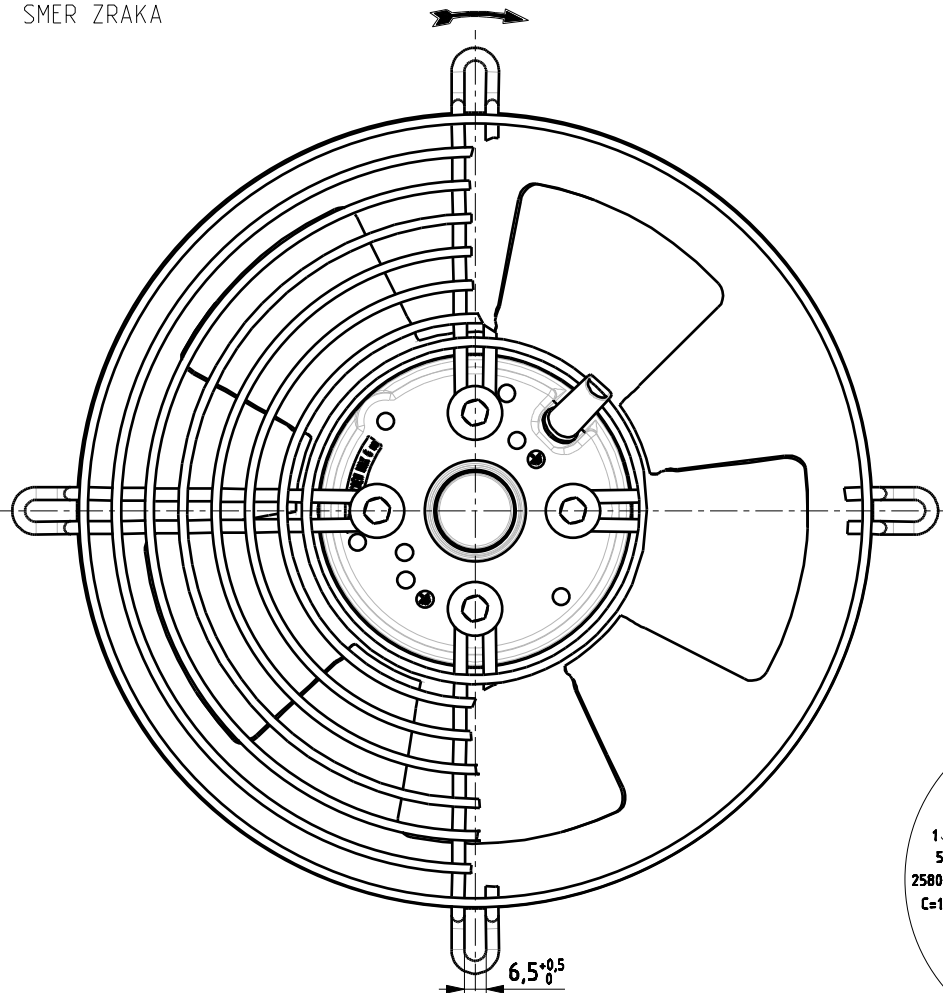

Navodilo za kontrolo ventilatorja 0301-1-4451
Checking instructions 0301-1-4451
V vsako škatlo priložiti priključno shemo 0301-1-0026
In each box must be enclosed connection diagram 0301-1-0026

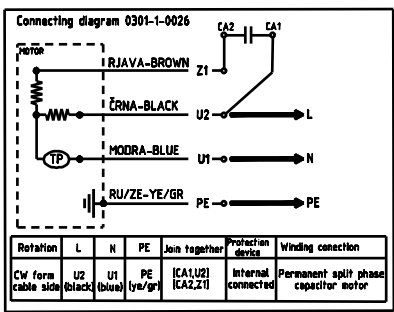

Hidria			METOLERANCE HERE INTOLERANCED DIM.		ISO 2768-m		MATERIAL		67:100 / A3			
Hidria Rotomatika			POVRŠINSKA OBR. SURFACE TEXTURE				MATERIAL					
					DATE	SIGNATURE	NAME TITLE					
					21-Jun-2005	Uroš K.	VENTILATOR R09R-2025A-2M-1511					
					21-Jun-2005	Matjaž B.						
							CODE					
							0309-4-0190					
							0309-4-0190					
							REVISION					
1	144/08	03-Apr-2008	Uroš K.	POTRDI								
ST	ST SPR	DATE	SIGNATURE									