
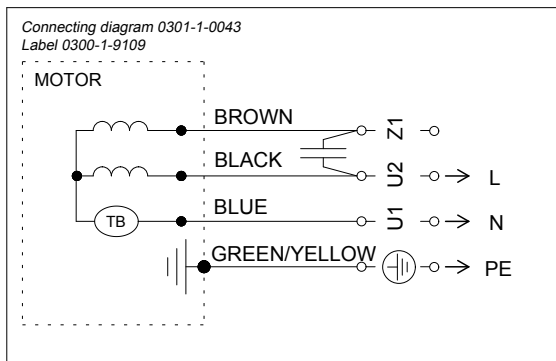
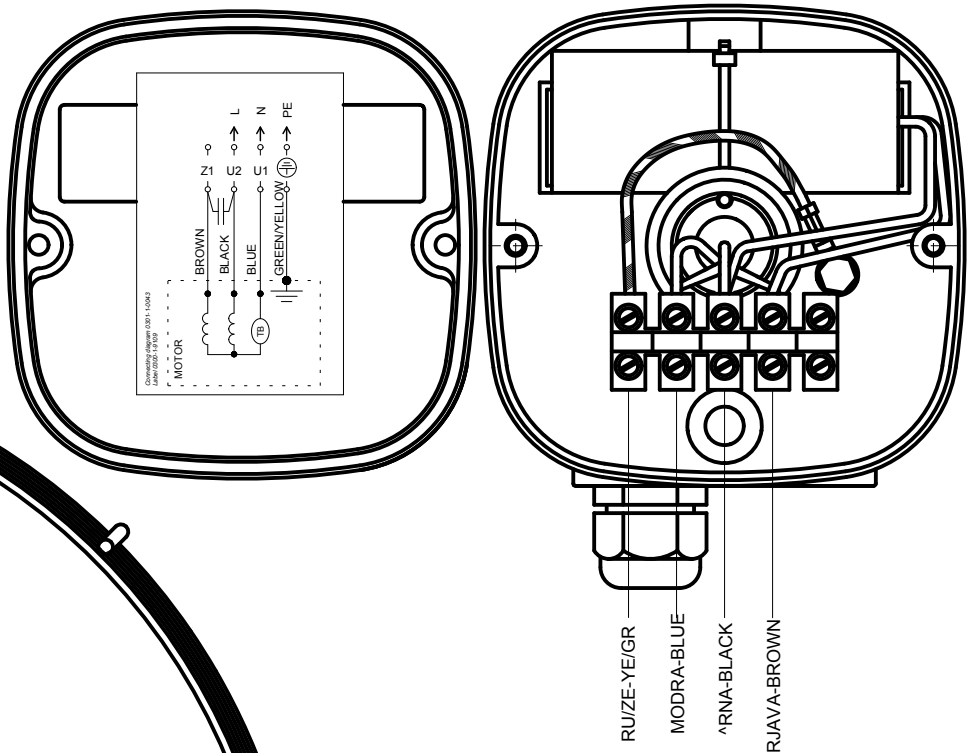
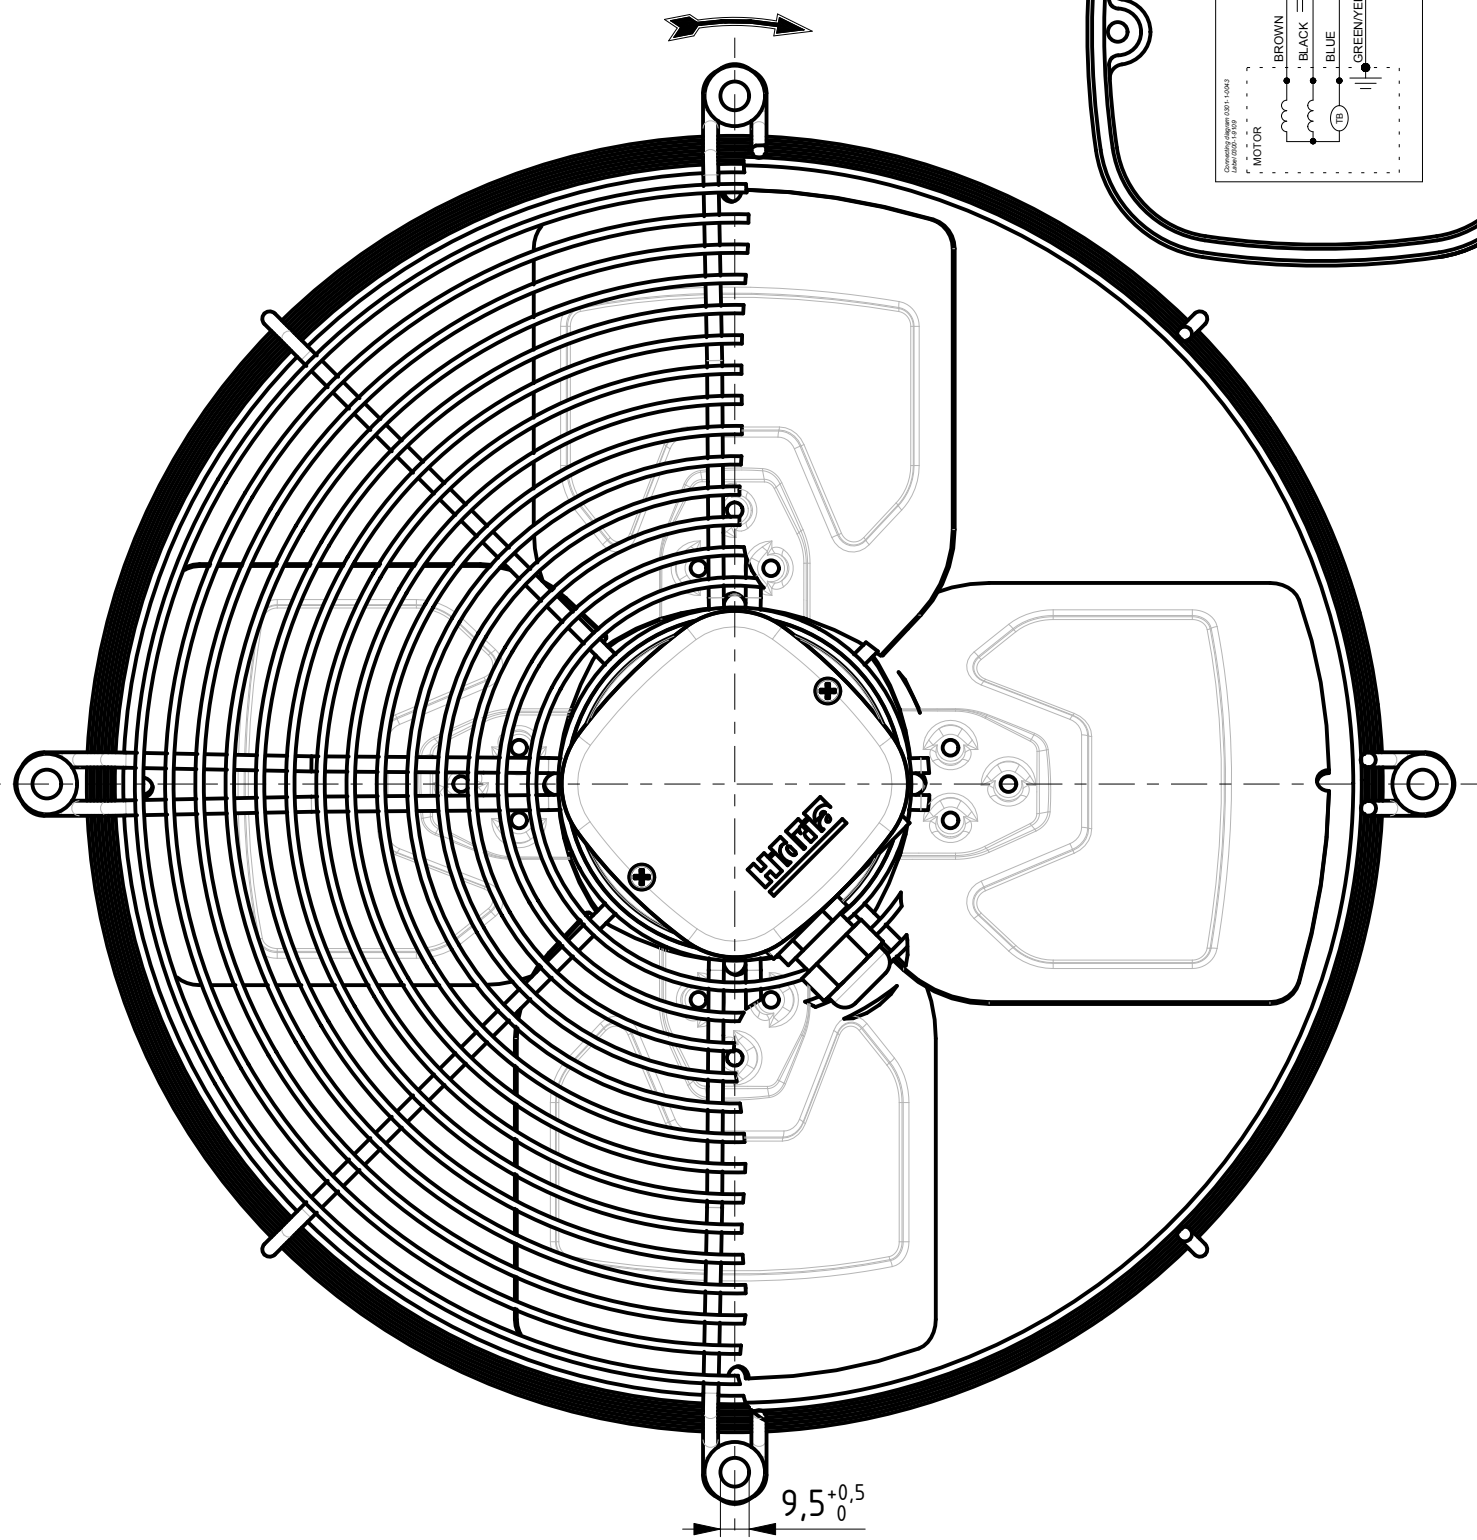


prenos tretjim osebam in uporaba v nedogovorjene namene ni dovoljen .
document must not be copied without our written permission and/or transferred to a third party for any unauthorized purpose.

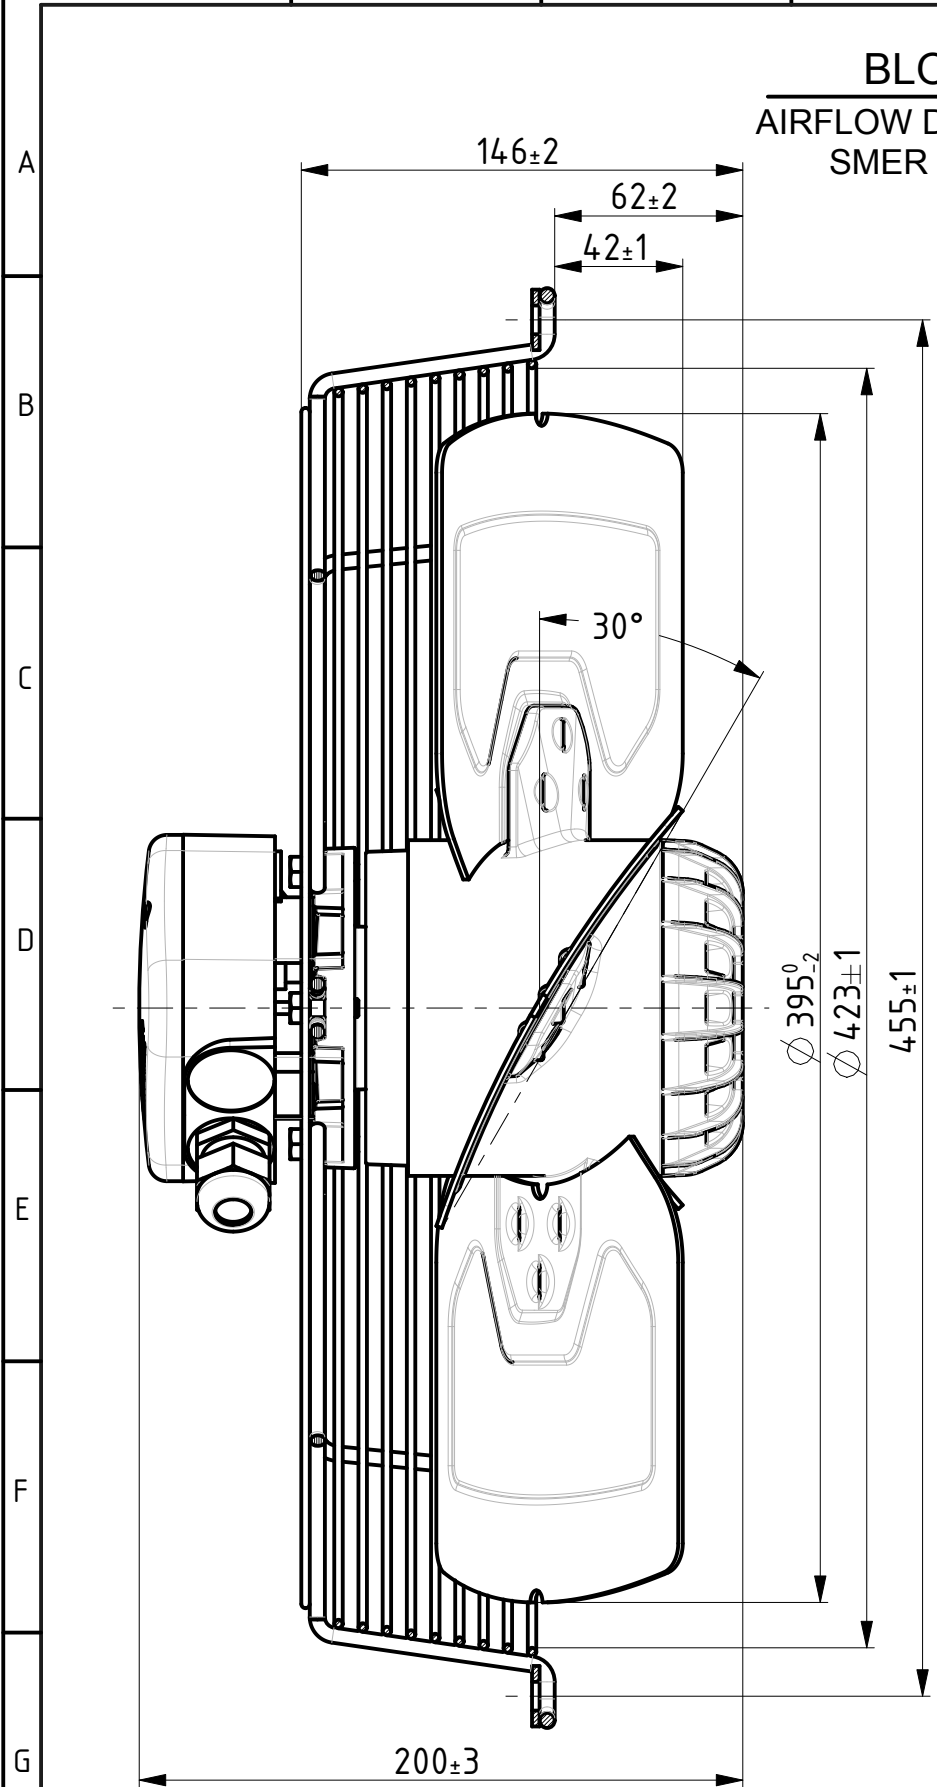

Opomba:
navedilo za kontrole ventilatorja 0301-1-1-1-73

MADE IN SLOVENIA

DATE

R11R-4030P-4M-5137

0311-4-0193

1~230V 50/60Hz 200/265W 0,90/1,15A 1345/1500RPM

MAX.AMB.60/45° C IP54 INS.CL.155 C=6,3µF/450V

TH.PROT. ROT. ←

			NETOLERIRANE MERE UNTOLERANCED DIM.		ISO 2768-m	MERIL0/F0RMAT	2:5 / A3		
POVR5INSKA 0BD. SURFACE TEXTURE			RISAL		29-Jan-2007	Uroš K.	MATERIAL		
Izdano			PROJEKTIRAL		29-Jan-2007	Stane P.	NAZIV: TITLE:		VENTILATOR R11R-4030P-4M-5137
			POTRDL ROTOMATIKA MOTORS				KODA: CODE:		0311 / 0103
			POTRDL SPE LIVARSTVO				VERZIJA: REV:		
			POTRDL SPE LAPELE				LIST: SHEET:		1