


prenos tretjim osebam in uporaba v nedogovorjene namene ni dovoljen .
document must not be copied without our written permission and/or transferred to a third party for any unauthorized purpose.



Rob rotorja in
rob prirobnice elise ventilatorja
morata biti poravnana

Opombe:
navedila za kontrolo ventilatorja 0301-1-9109

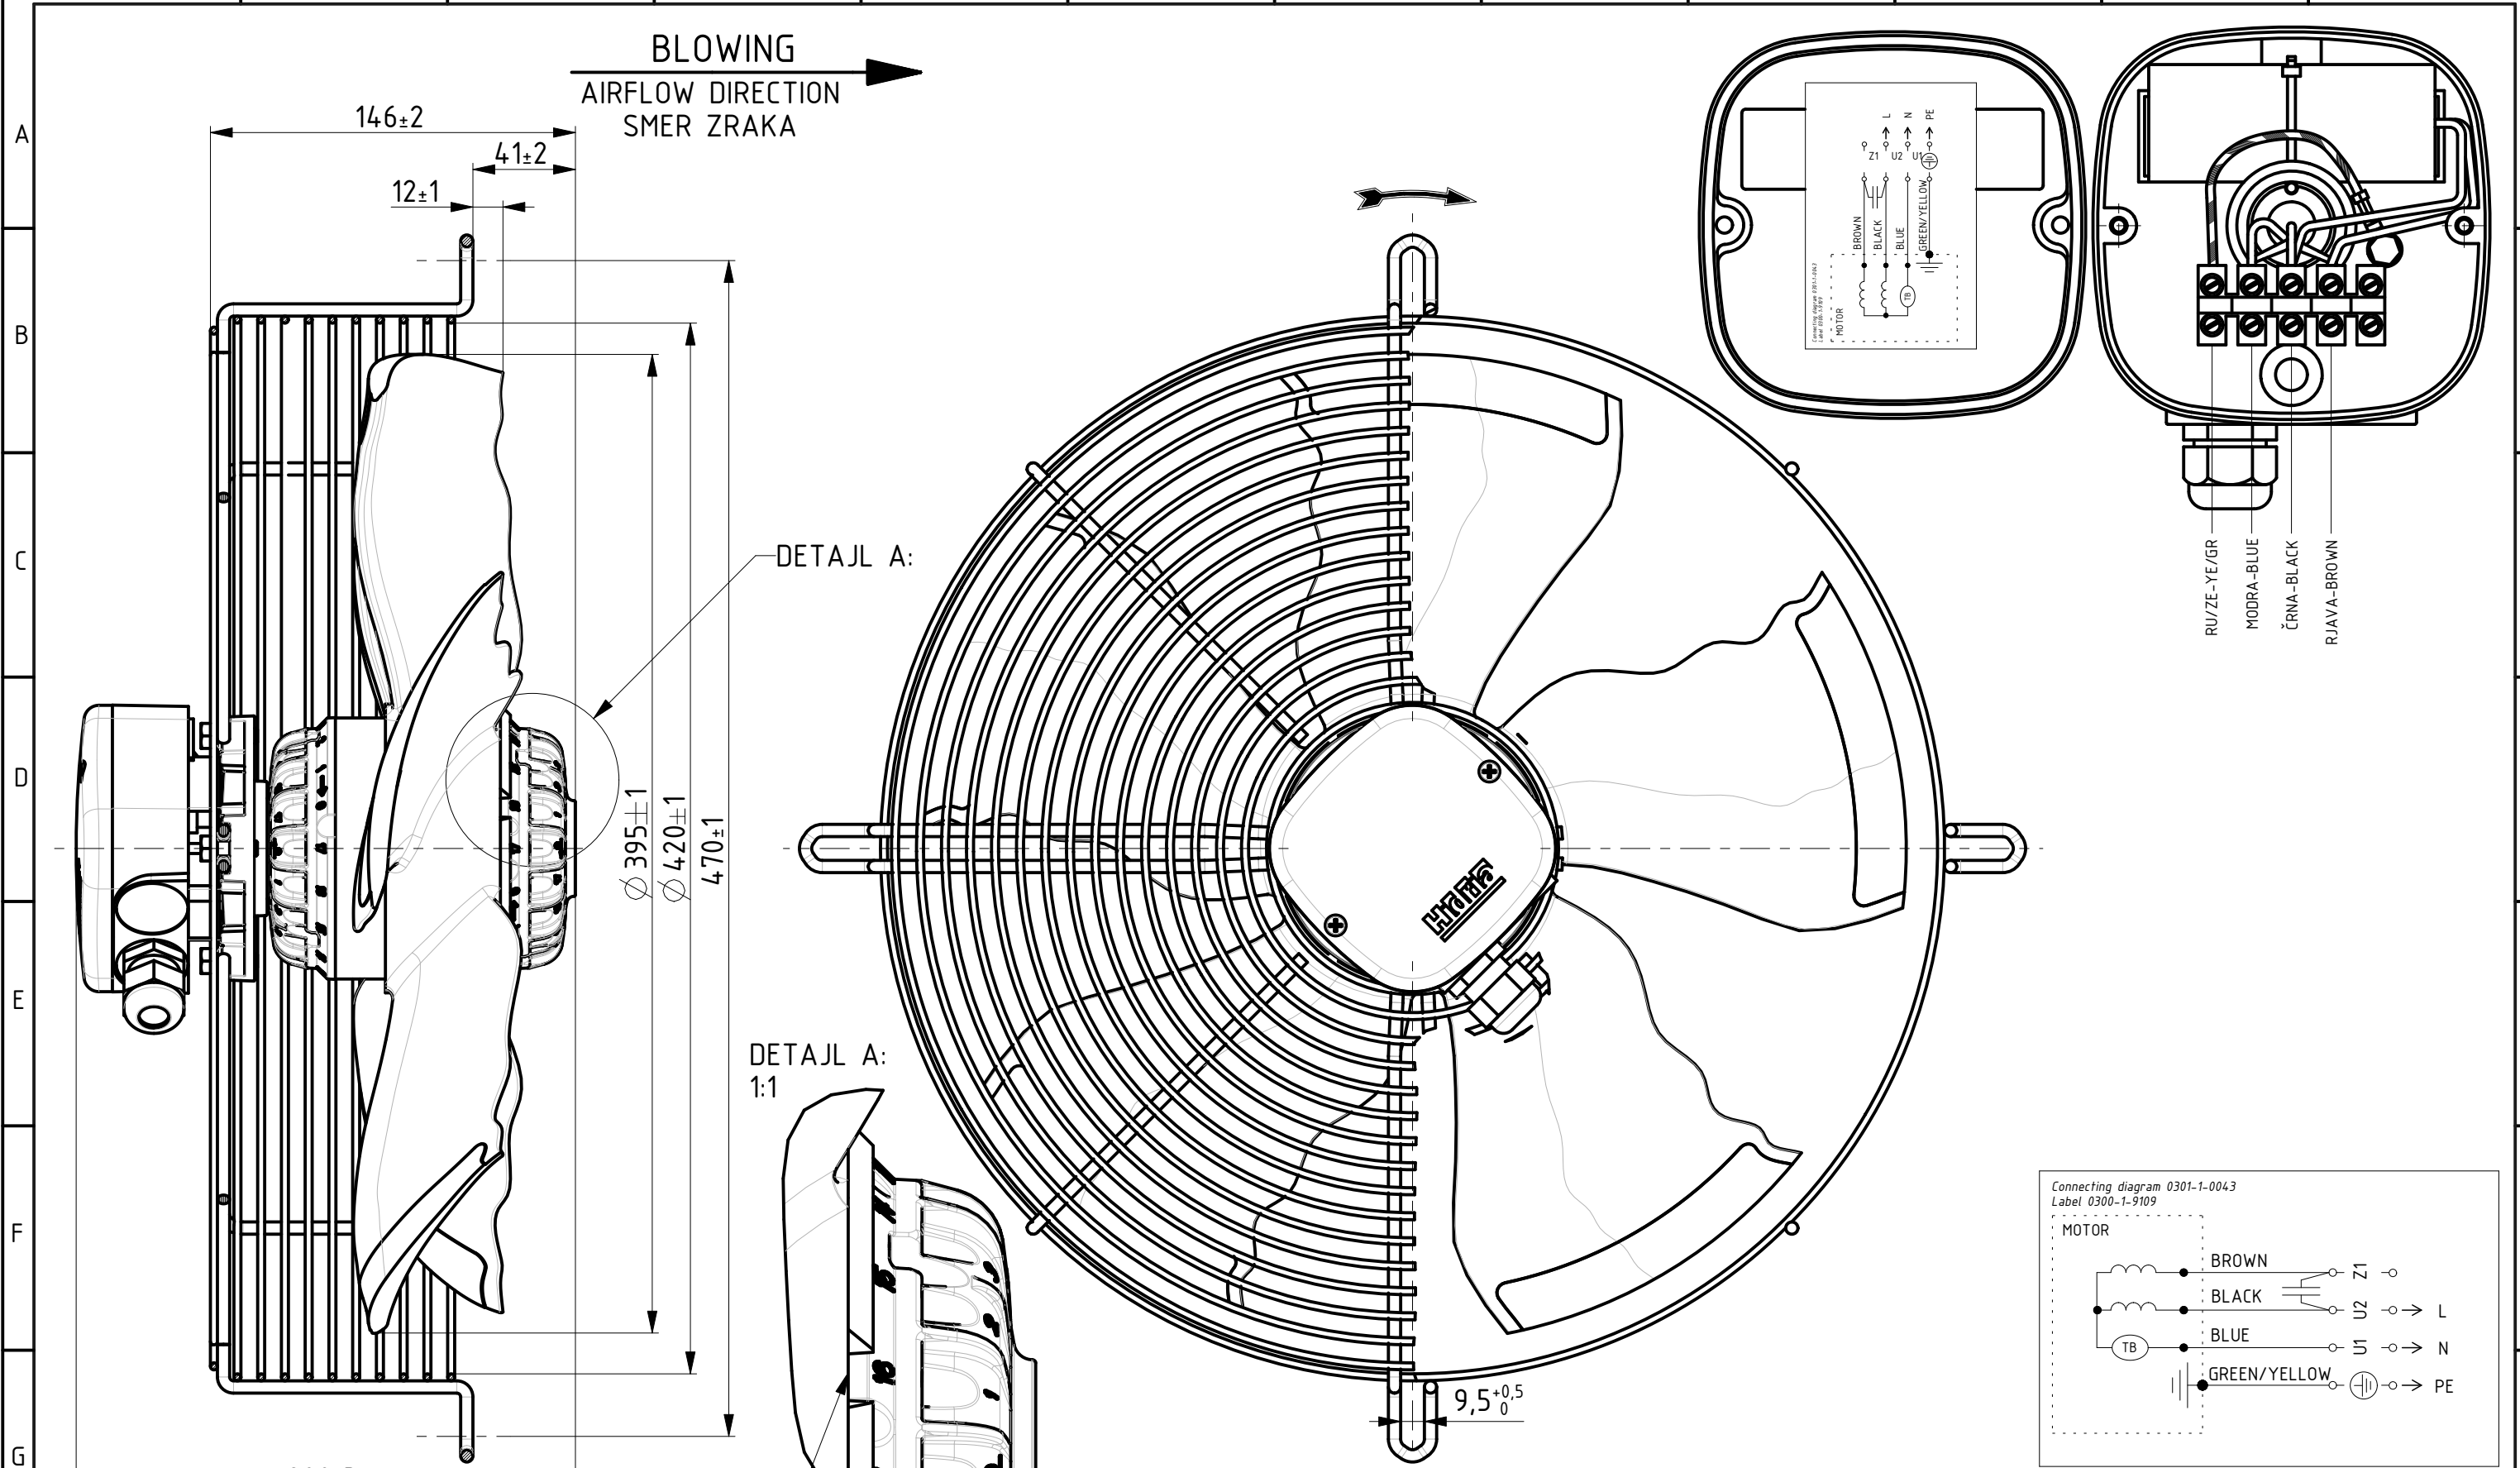

MADE IN SLOVENIA



DATE


R11R-40LPB-4M-5150

0311-4-0342

1~230V 50/60Hz 190/260W 0,85/1,10A 1310/1450RPM

MAX.AMB.70/55° C IP54 INS.CL.155 C=6,3pF/450V

TH.PROT. ROT. 

				NETOLERIRANE MERE UNTOLERANCED DIM.				ISO 2768-m				MERILO/FORMAT 2:5 / A3									
				POVRŠINSKA OBD. SURFACE TEXTURE								MATERIAL									
Izdano										DATUM		PODPIS		NAZIV: TITLE: VENTILATOR R11R-40LPB-4M-5150							
								RISAL		11-Avg-2009		Uroš K.									
				PROJEKTIRAL		11-Avg-2009		Matej B.													
				POTRDL ROTOPISTIKA MOTORS																	
4	271/12	05-Dec-2012	Uroš K.	POTRDL SPE LIVARSTVO																	
3	184/10	17-Avg-2010	Uroš K.	POTRDL SPE LAMELE						KODA: CODE:				VERZIJA: REV:				LIST: SHEET:			
2	359/09	02-Okt-2009	Uroš K.	POTRDL																	
														0311 / 0312							