


prenos tretjim osebam in uporaba v nedogovorjene namene ni dovoljen .
document must not be copied without our written permission and/or transferred to a third party for any unauthorized purpose.



Opombe:

navedila za kontrolo ventilatorja 0301-1-0044

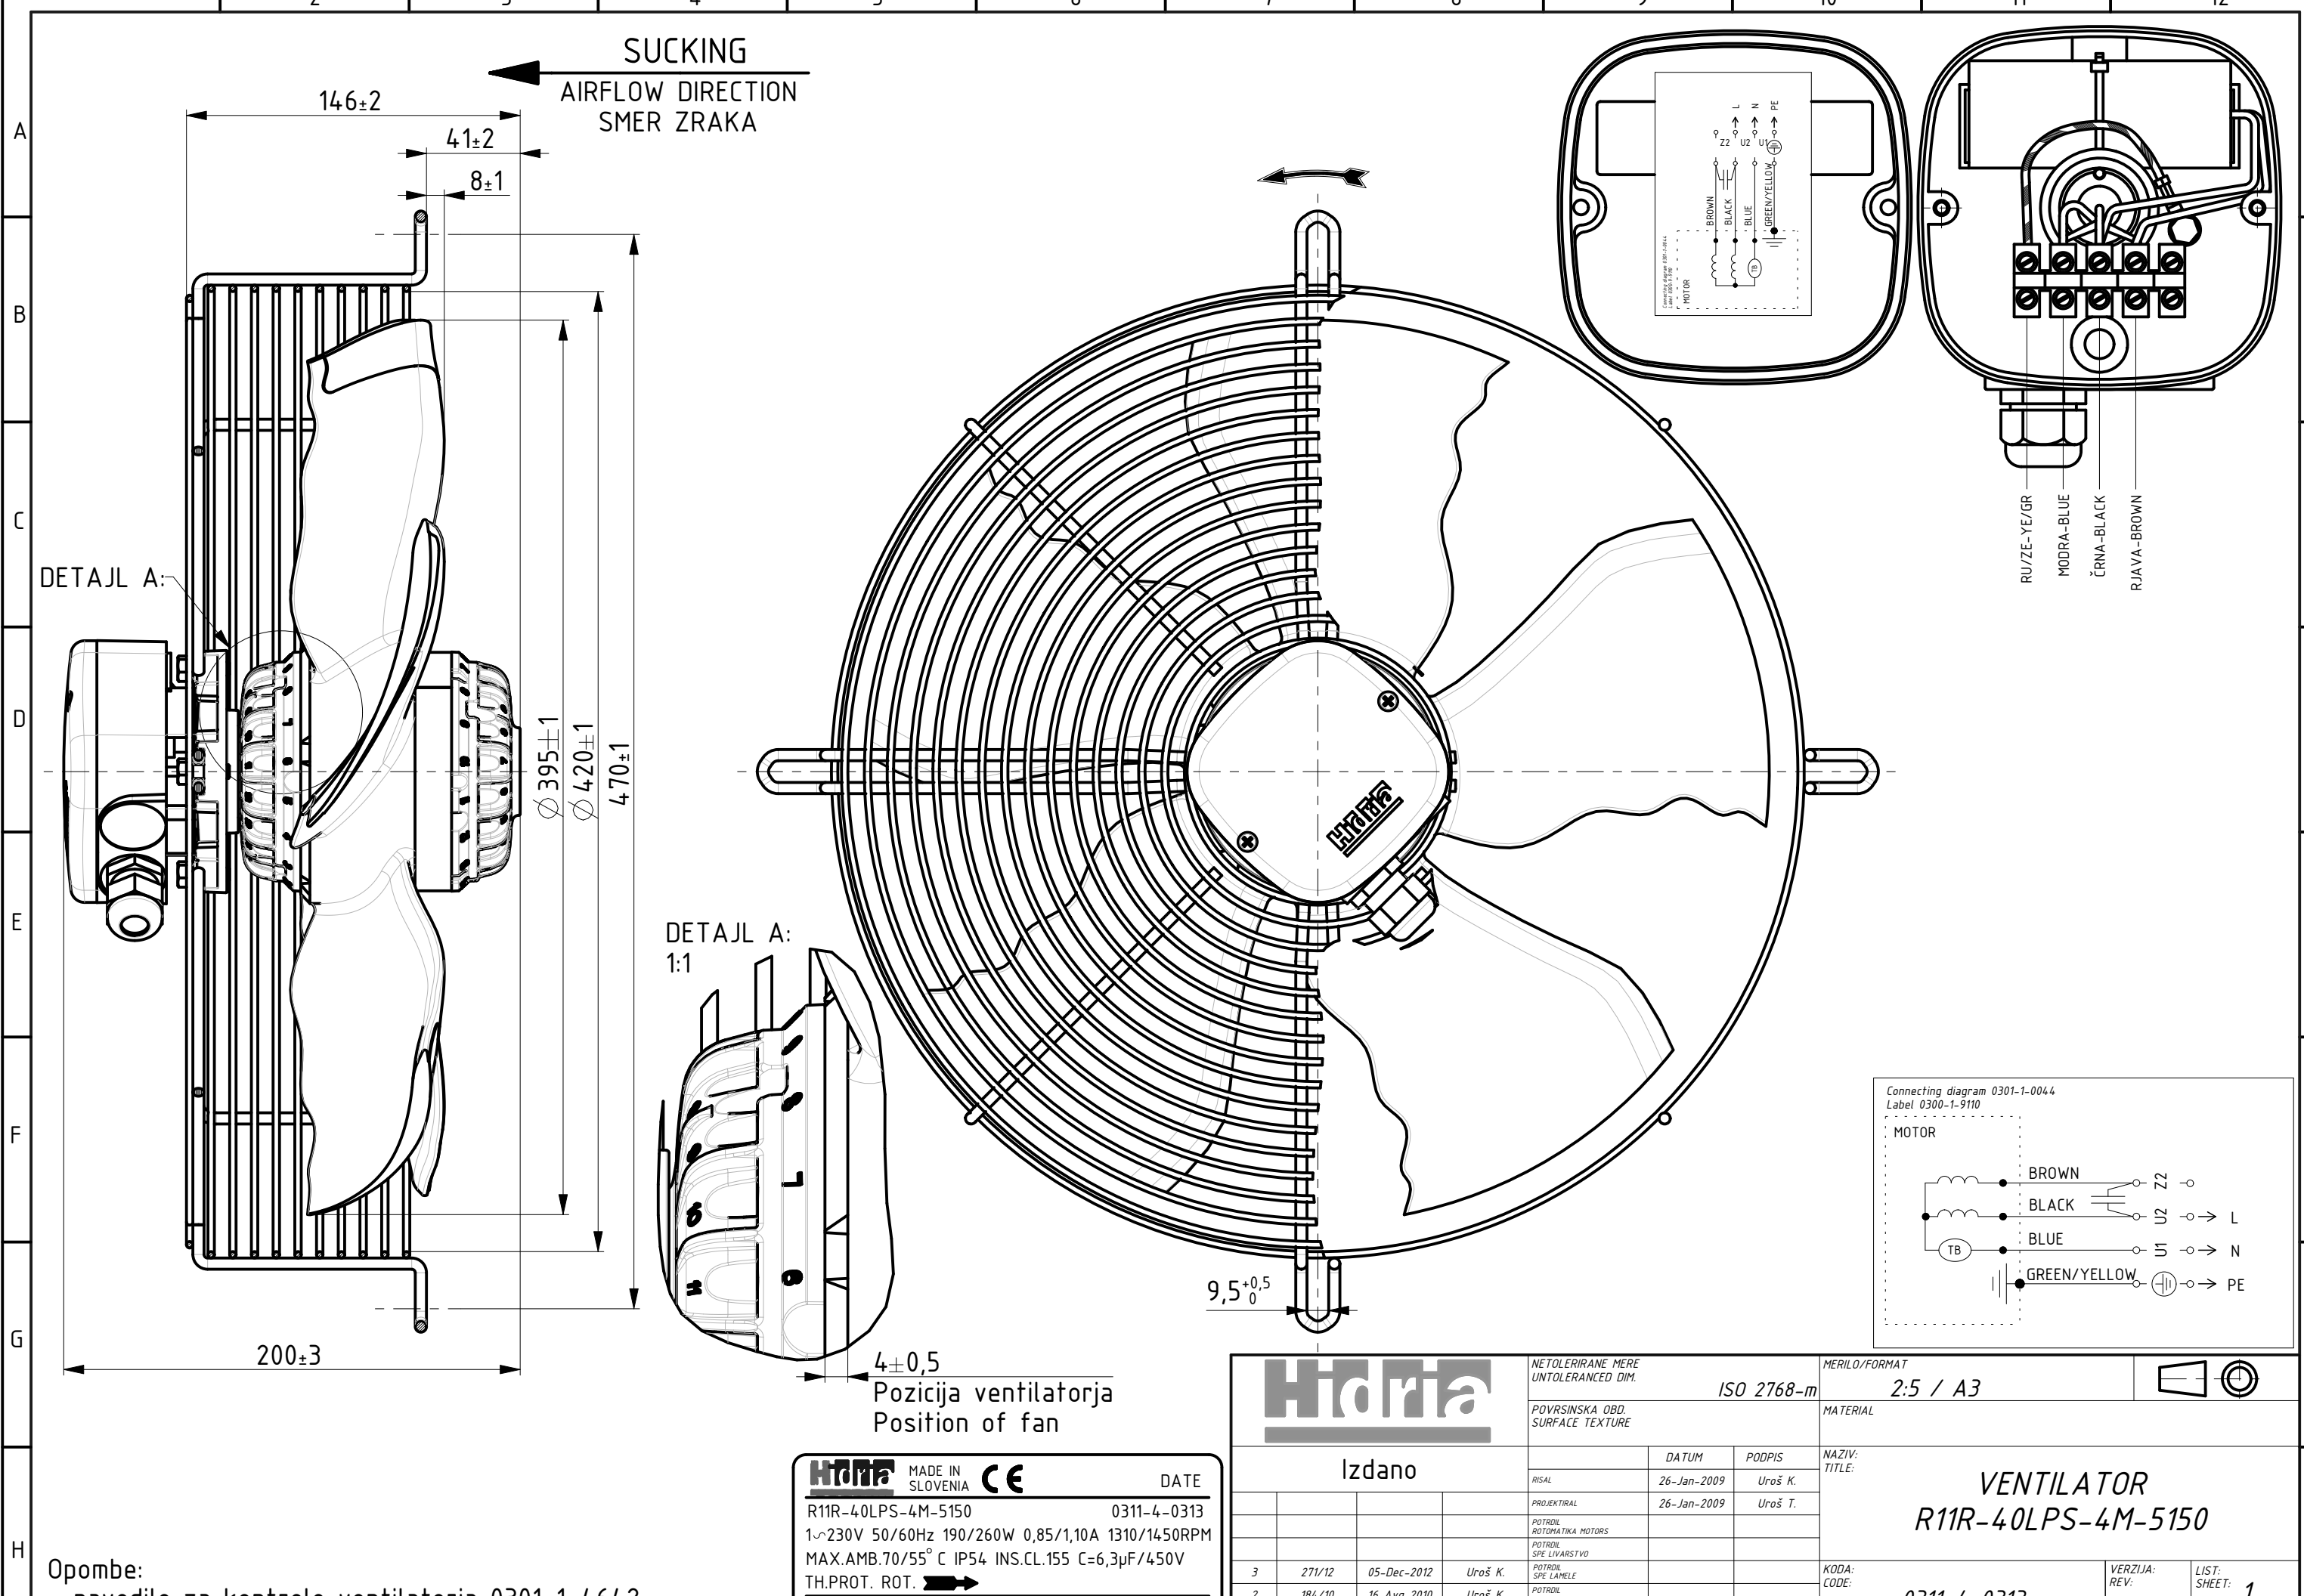

MADE IN SLOVENIA



DATE


R11R-40LPS-4M-5150

0311-4-0313

1~230V 50/60Hz 190/260W 0,85/1,10A 1310/1450RPM

MAX.AMB.70/55° C IP54 INS.CL.155 C=6,3pF/450V

TH.PROT. ROT. 

			NETOLERIRANE MERE UNTOLERANCED DIM.		ISO 2768-m	MERIL/FORMAT	2:5 / A3	
POVRŠINSKA OBD. SURFACE TEXTURE			RISAL		26-Jan-2009	UROŠ K.	MATERIAL	
Izdano			PROJEKTIRAL		26-Jan-2009	UROŠ T.	NAZIV: TITLE:	VENTILATOR R11R-40LPS-4M-5150
3			271/12		05-Dec-2012	UROŠ K.	KODA: CODE:	
2			184/10		16-Apr-2010	UROŠ K.	VERZIJA: REV:	LIST: SHEET: 1