


prenos tretjim osebam in uporaba v nedogovorjene namene ni dovoljen .
document must not be copied without our written permission and/or transferred to a third party for any unauthorized purpose.


H

Opomba:




navedilo za kontrolo ventilatorja 0301-1-9124

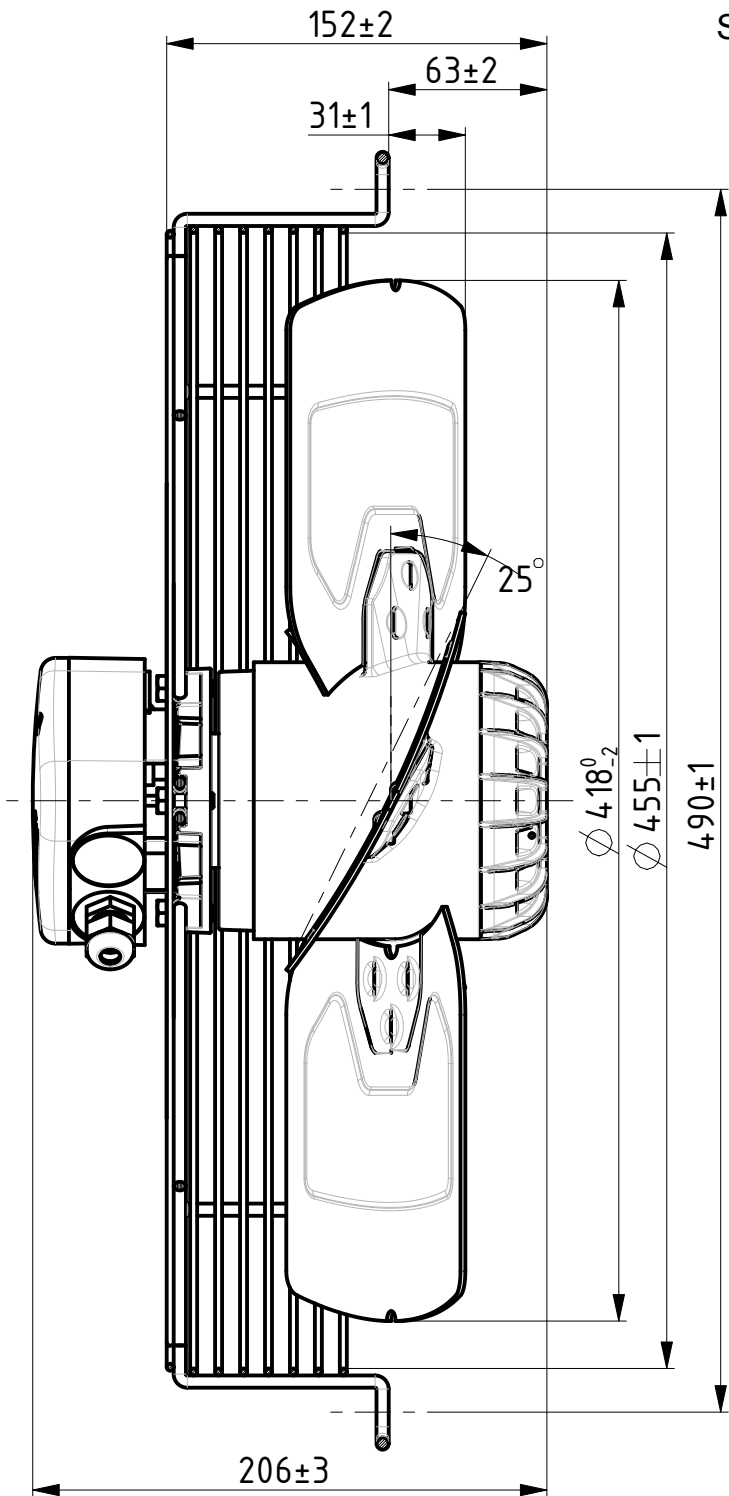

SUCKING
AIRFLOW DIRECTION
SMER ZRAKA

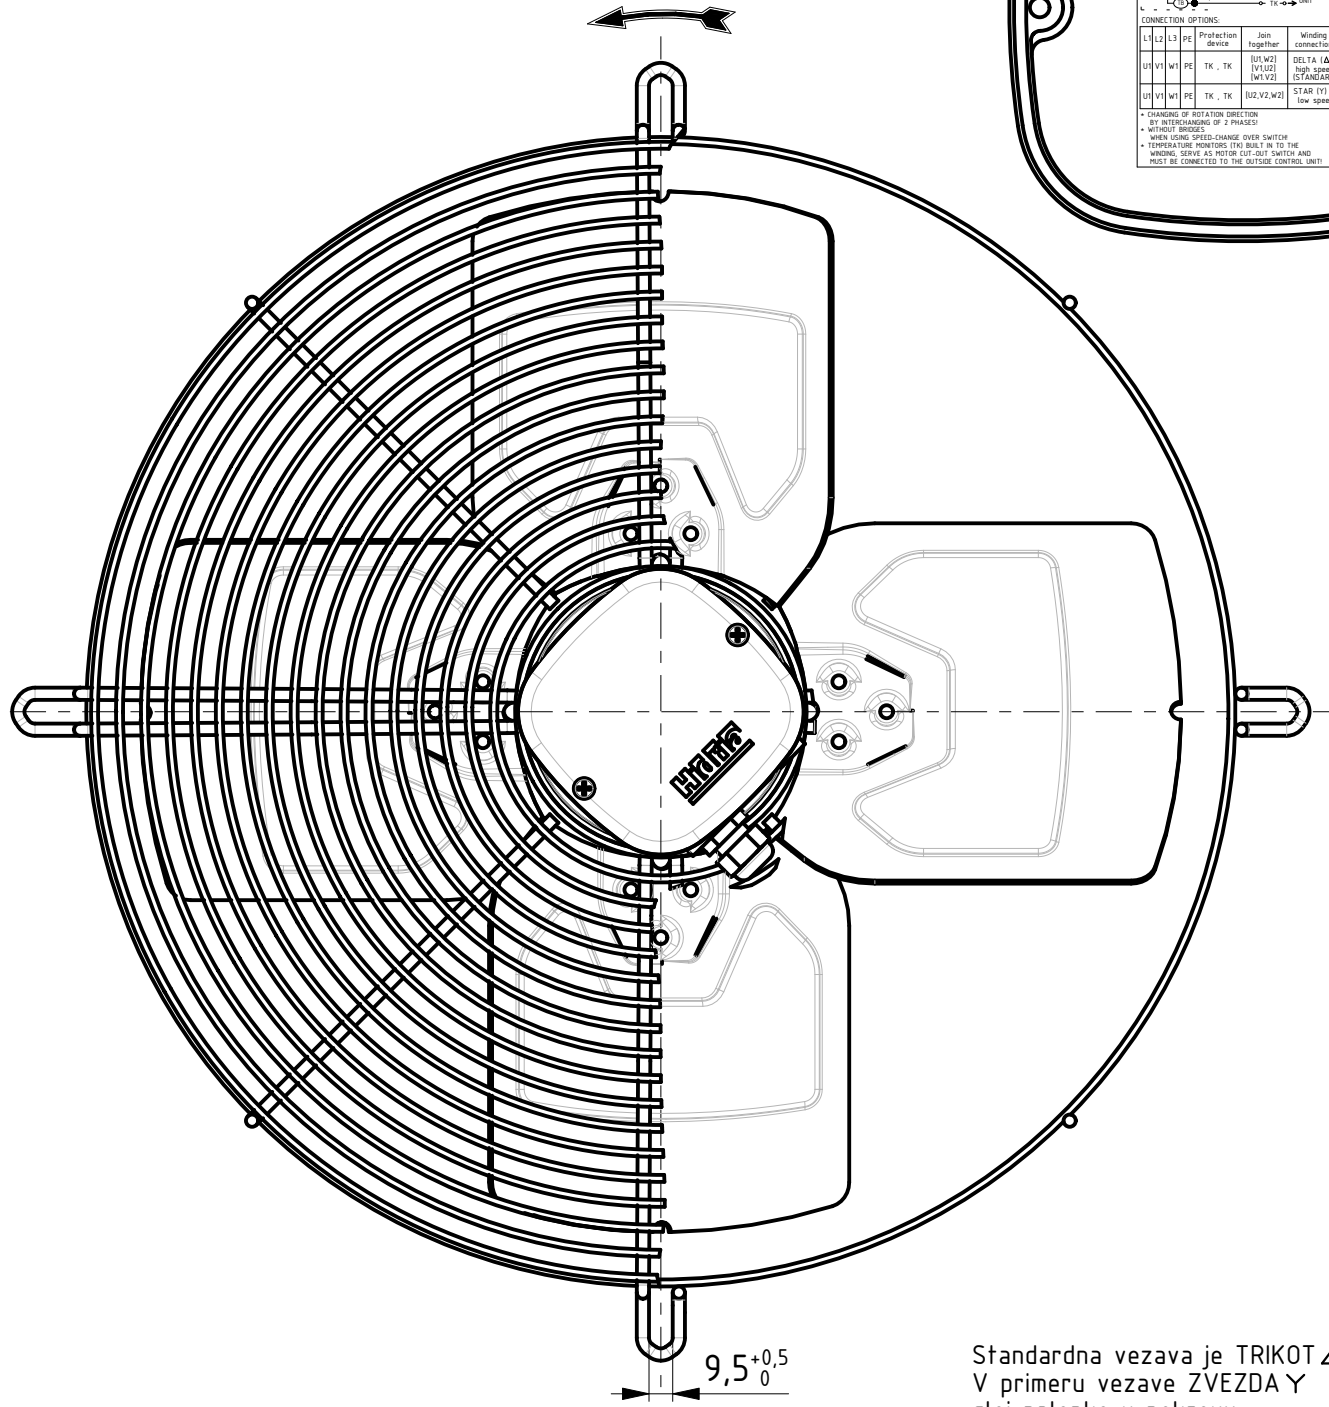

Standardna vezava je TRIKOT Δ
V primeru vezave ZVEZDA Y
glej nalepko v pokrovu
Standard connection scheme is DELTA Δ
If required STAR Y see the
connection diagram in the cover

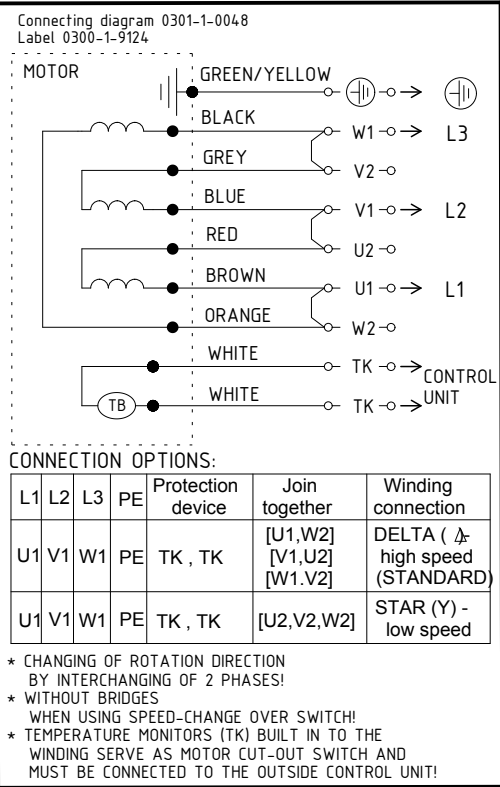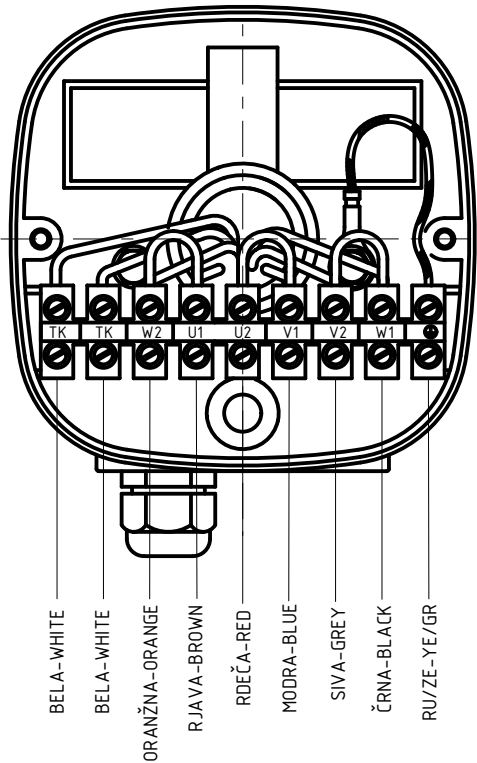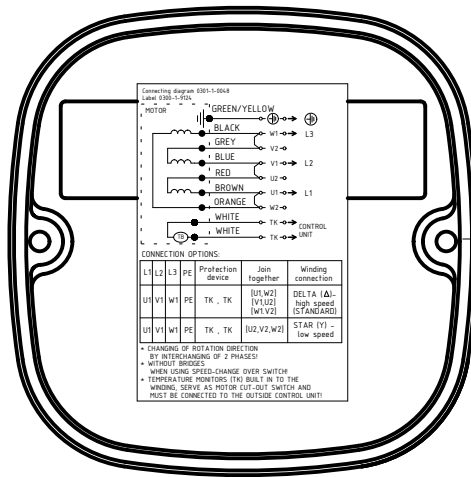

HMP MADE IN SLOVENIA **CE** DATE 0311-4-0277

R11R-4225A-4T2-5745

3~400V 50Hz D/Y 215/165W 0,51/0,26A 1410/1240RPM MAX.AMB.70° C

3~400V 60Hz D/Y 305/220W 0,56/0,37A 1410/1300RPM MAX.AMB.60° C

IP54 INS.CL.155

TH.PROT. ROT.

HMP			NETOLERIRANE MERE UNTOLERANCED DIM.	ISO 2768-m	MERIL/FORMAT 33:100 / A3	
Izdano			POVRŠINSKA OBD. SURFACE TEXTURE		MATERIAL	
			RISAL	DATUM 15-Nov-2006	PODPIS Uroš K.	NAZIV: TITLE: VENTILATOR R11R-4225A-4T2-5745
			PROJEKTIRAL	15-Nov-2006	Matjaž B.	
			POTRDL ROBOTIKA MOTORS			
			POTRDL SPE LITARSTVO			
			POTRDL SPE LAMELE			
			POTRDL			
2	250/12	23-Nov-2012	Uroš K			KODA: CODE: 0311 / 0277
						VERZIJA: REV: LIST: SHEET: 1