



prenos tretjim osebam in uporaba v nedogovorjene namene ni dovoljen .
document must not be copied without our written permission and/or transferred to a third party for any unauthorized purpose.

Opomba:



Vzmetna ploščica na kabelski strani

navedilo za kontrole ventilatorja 0301-1-1.285

SUCKING
AIRFLOW DIRECTION
SMER ZRAKA

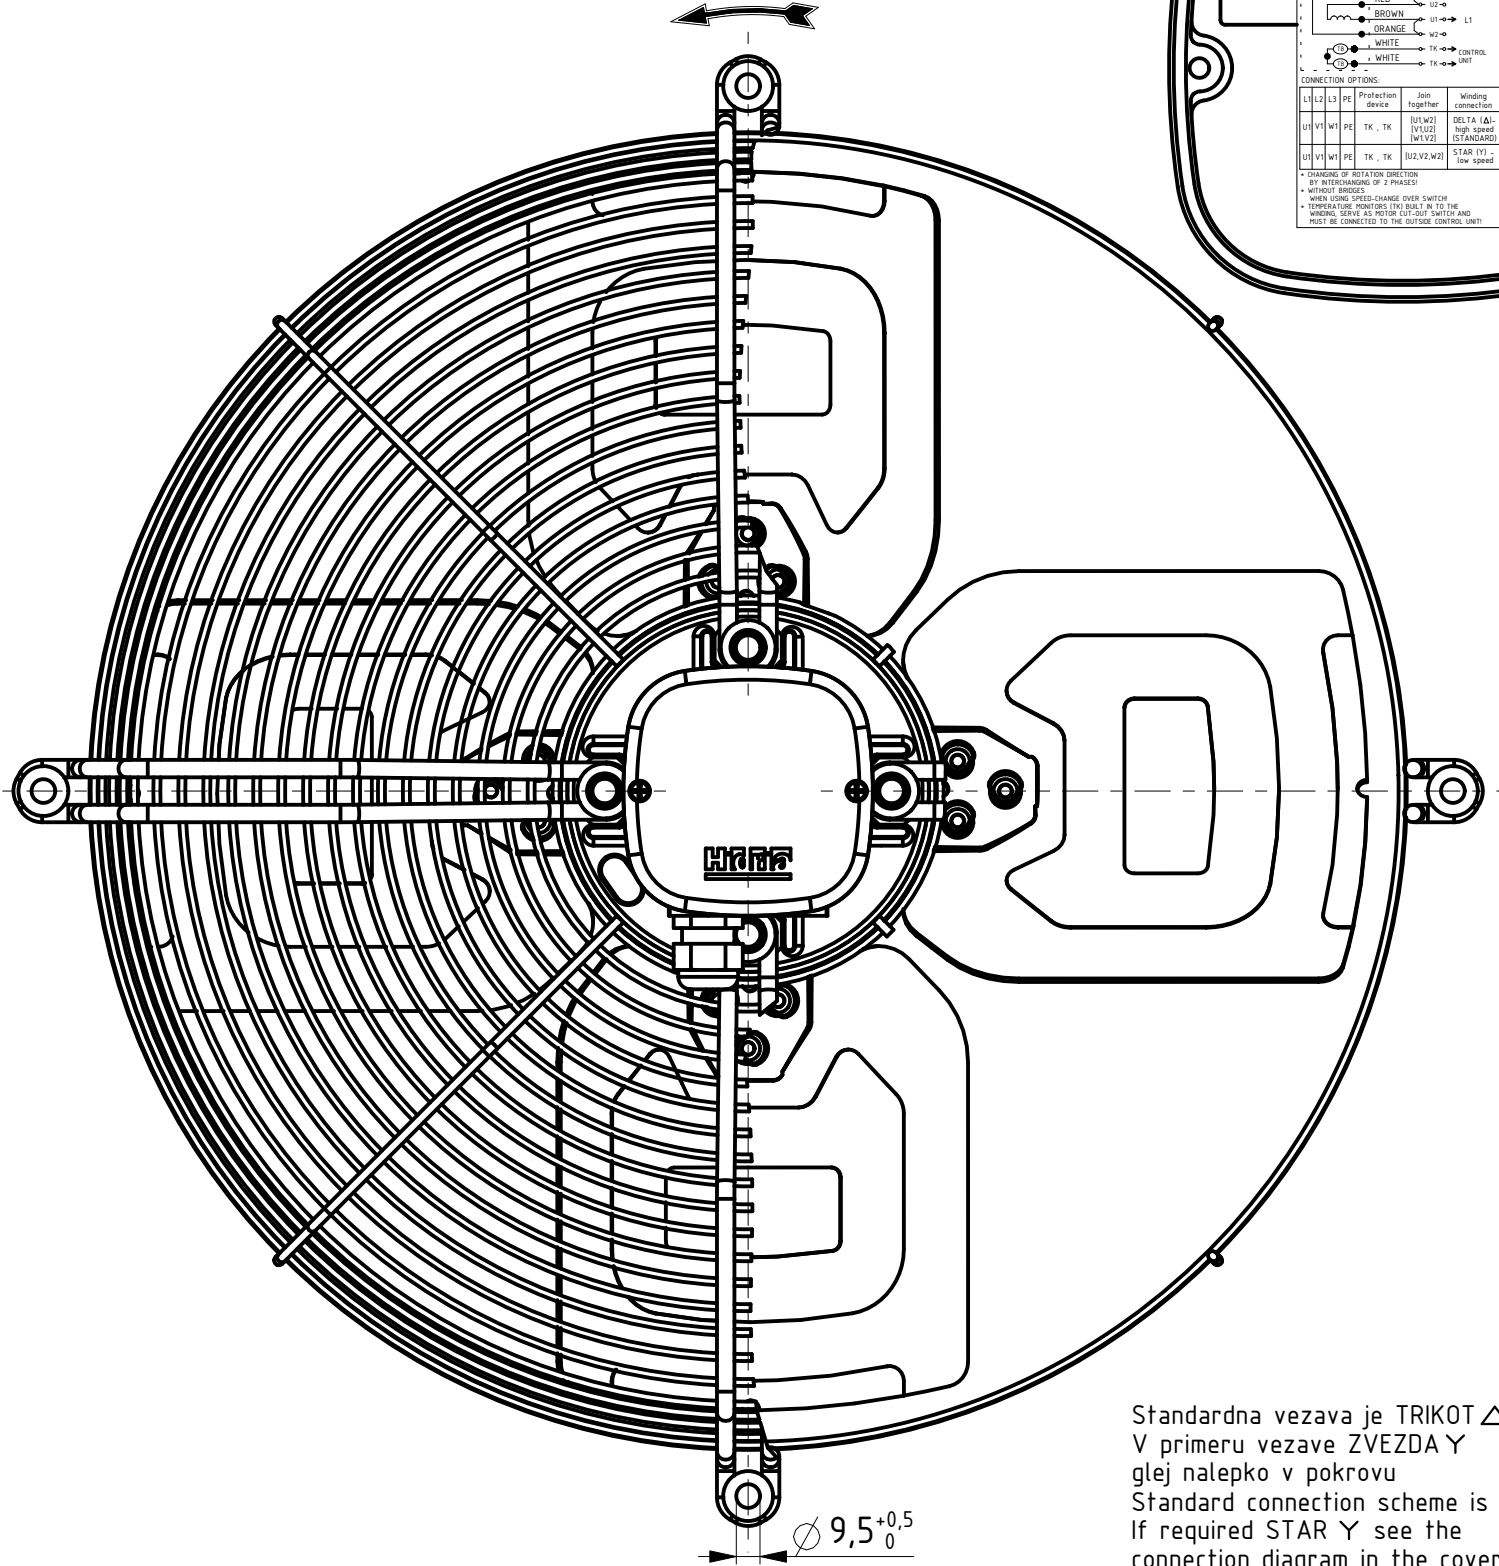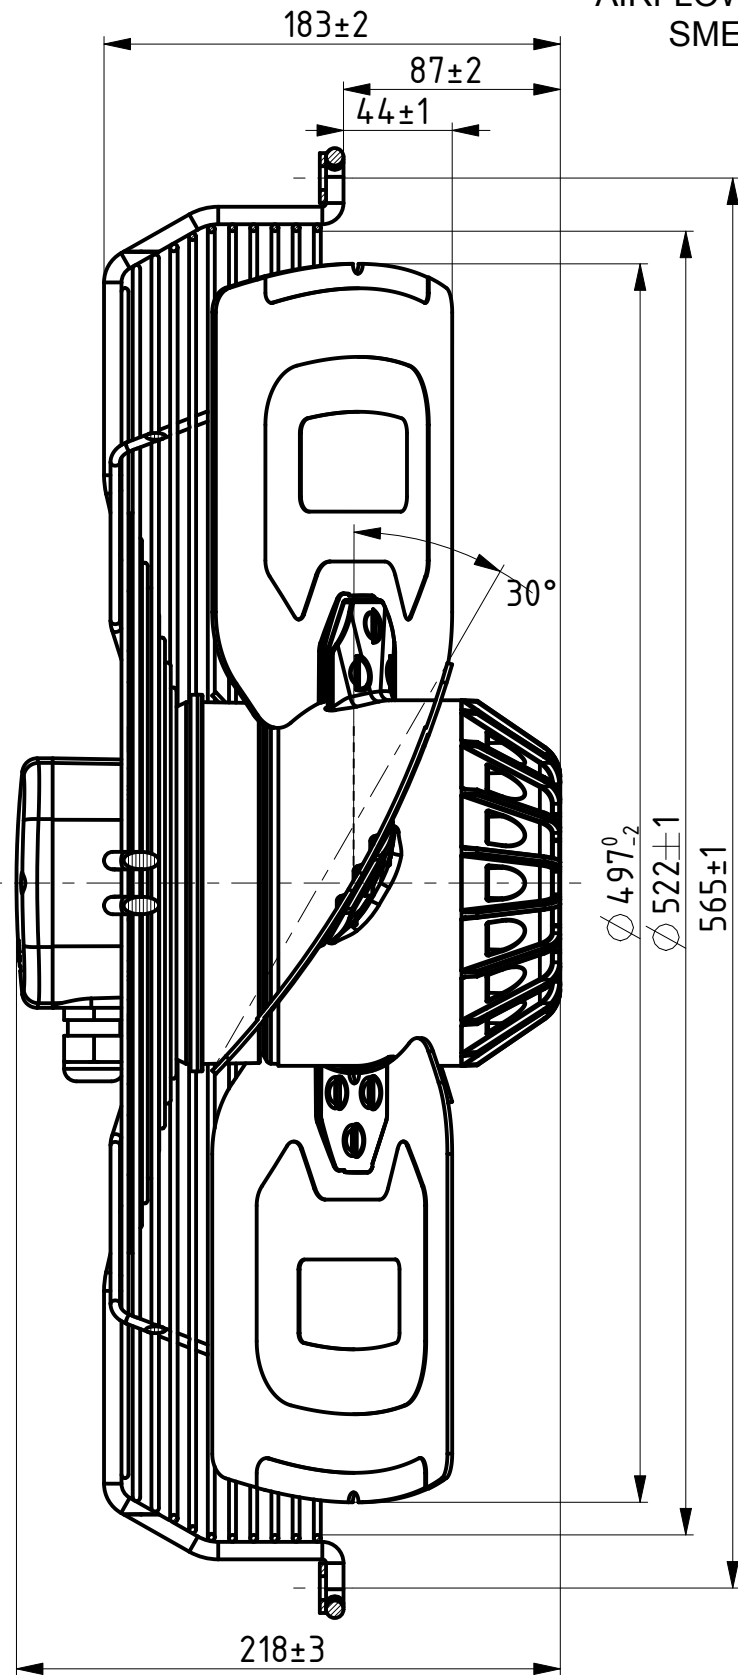

Standardna vezava je TRIKOT Δ
V primeru vezave ZVEZDA Y
glej nalepko v pokrovu
Standard connection scheme is DELTA Δ
If required STAR Y see the
connection diagram in the cover

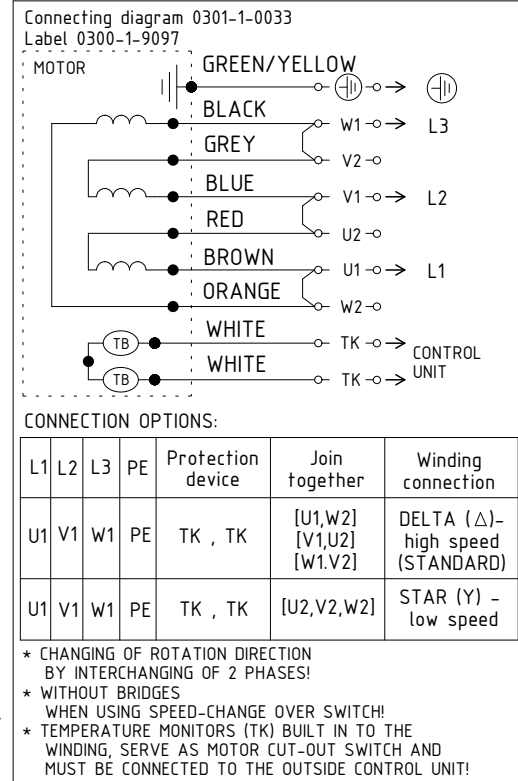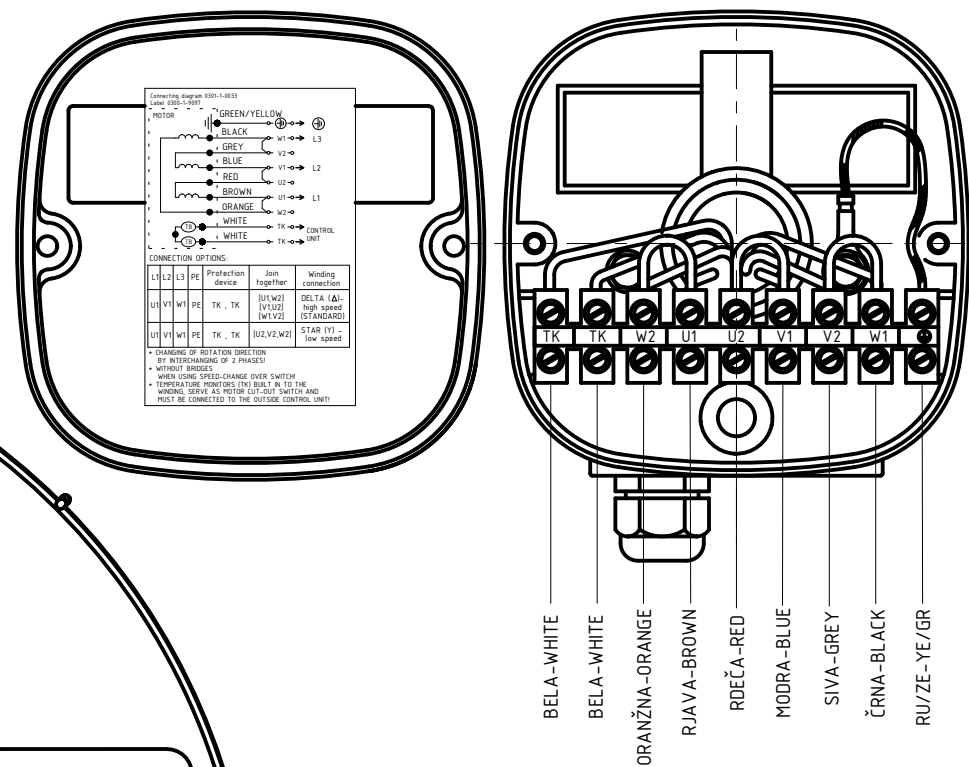

Horta

NETOLERIRANE MERE
UNTOLERANCED DIM.

MERIL/FORMAT
33:100 / A3

POVRŠINSKA OBD.
SURFACE TEXTURE

MATERIAL

Izdano

DATUM
13-Sep-2003

PODPIS
Uroš K.

NAZIV:
TITLE:

VENTILATOR
R13R-5030A-4T2-7002

KODA:
CODE:

0301-1-0006

VERZIJA:
REV:

LIST:
SHEET: 1

Horta

MADE IN
SLOVENIA

CE

DATE

R13R-5030A-4T2-7002 0313-4-0006

3~400V 50Hz D/Y 560/410W 1,25/0,70A 1380/1170RPM

MAX.AMB.70° C IP54 INS.CL.155

TH.PROT. ROT. →