

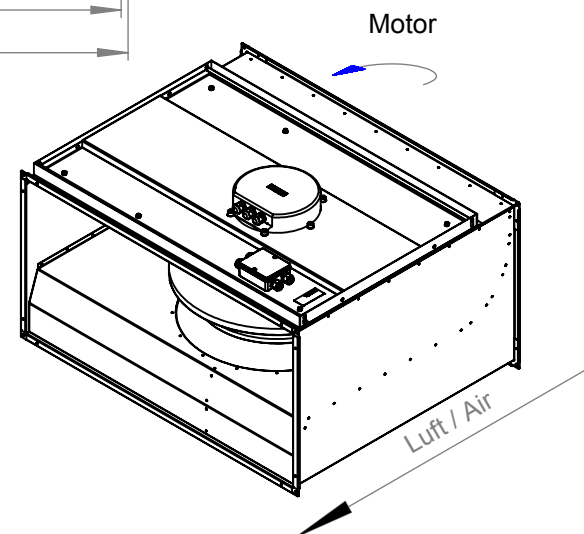
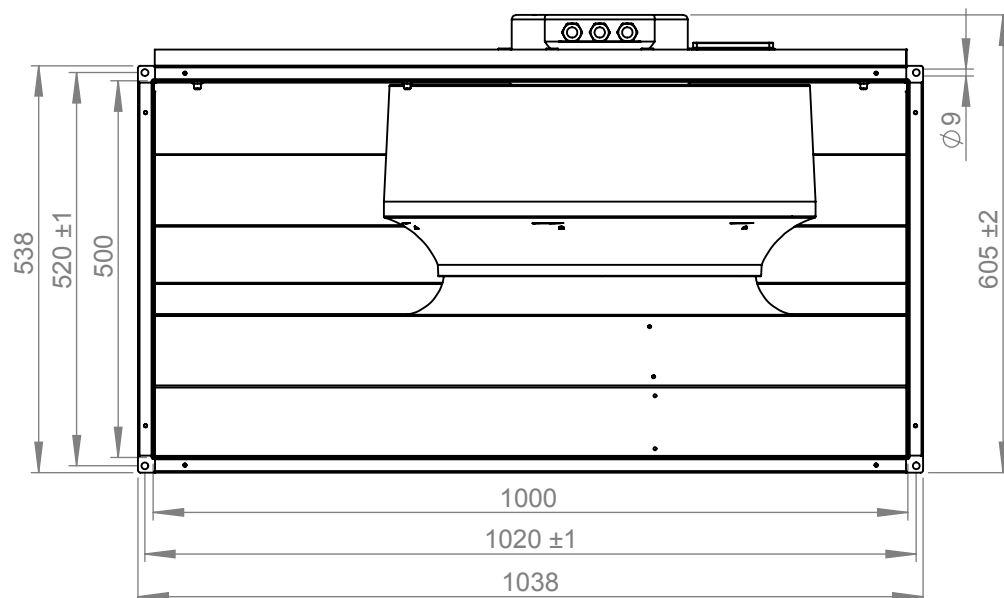


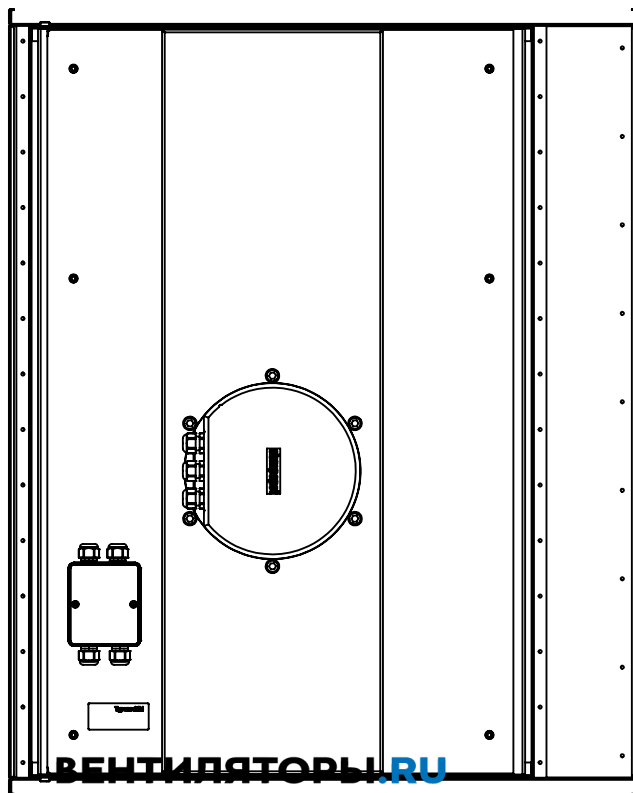

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

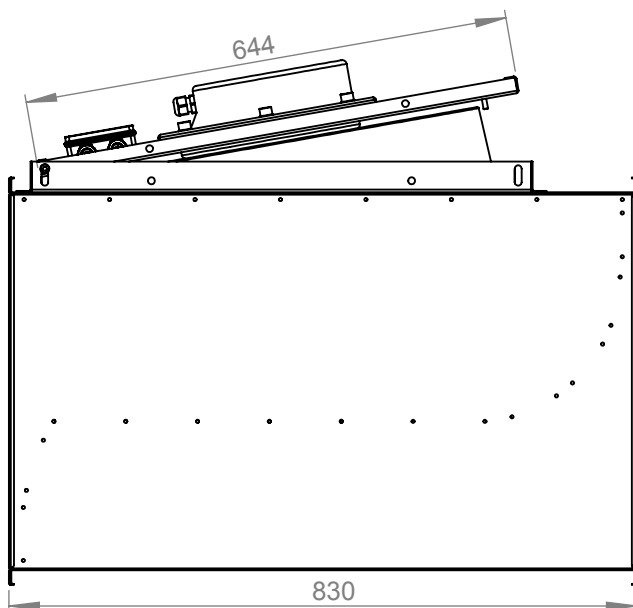

Protection Mark
according to ISO 16016

1:20 A4 mm

General tolerances
DIN ISO 2768-c

KVR10050EC30

Drawn: d.ursu
Created: d.ursu
Changed:

24.11.2014
24.11.2014

131373 00

E-mail: zakaz@ventilatorry.ru